

TECHNICAL ARTICLE

Drum filling and the ignition risks of static electricity

Protecting workers and company assets from ignitions caused by static electricity can't be left to chance. In facilities where flammable and combustible products are processed, there's a very high probability that static electricity is generated by the movement and agitation of vapors, liquids and solids.

In filling operations, thousands of drums of flammable liquids are filled worldwide every week and filling procedures vary from facility to facility. The risk of a fire or explosion caused by a discharge of static electricity in an EX/HAZLOC area is just too significant to ignore. However, despite the risks, good housekeeping, strict maintenance practices, and ignition risk identification, underpinned by static control mitigation measures, can ensure a safe working environment.

In industrial environments where there can potentially be flammable and combustible atmospheres, there are many metallic isolated conductors which, if not suitably grounded, can become electrostatically charged to a hazardous level. Isolated conductors are likely sources of static ignition incidents in industry, ranging from small-scale fires through to major explosion damage and injury to facilities and personnel.



Drum filling using a Bond-Rite® REMOTE and Bond-Rite® EZ

Mobile items of plant equipment such as drums and trolleys cannot be permanently connected to ground through the main plant structure due to the need to be transportable as part of the process operation. That said, it is an absolute minimum requirement that each vessel should be grounded whenever a flammable mixture could be present and those responsible for introducing control measures should be proactive in their approach.

Repeatability and risk

In industry, batch processes can require many hundreds or even thousands of earth connections to be made and broken every day, it is essential that good earth contact is made each and every time. The effectiveness, reliability and durability of any grounding clamp, system and associated cabling is therefore key to keeping process operations safe from the dangers of a static discharge. The speed and scale of modern manufacturing processes coupled with changes to the nature and properties of many raw materials have increased the range and number of applications where electrostatic charge can accumulate.

Drum filling operations require repeat filling of drums on a continuous basis. Drums can be filled with:

- Fixed pumps that simultaneously fill four drums on a pallet.
- Fixed pumps on a rolling conveyor system.
- Portable pumps in a manual process operation.



As operations are typically carried out indoors, hazardous areas ranging from Class I Division 1 right through to non-hazardous safe areas can reflect a matrix of installation options and required layers of control that provide the best fit for the grounding applications. Different hazardous location requirements coupled with the characteristics of the operation and scale of the hazard, particularly the amount of flammable or combustible material at risk of ignition, can influence the kind of solution specified.

Incident Type	Incident Number	Facility	Date	Location	Casualties
Explosion	1	Large Storage Tank	1953	Germany	29 Fatalities
Explosion	2	Large Storage Tank	1954	The Netherlands	-
Explosion	1	Loading Tanker	1956	USA	-
Explosion	1	Tanker	1966	USA	-
Explosion	3	Crude Oil Tankers	1969	The Netherlands	5 Fatalities and 100 Injuries
Fire and Explosion	303	Filling of Containers (storage tanks, road, rail tanks and drums)	1979-1988	UK	-
Fire	243	Petrol Stations	1993-2004	Around the World	-

*Table I – Summary of static ignition incidents
(Source: "An on static electricity", Disaster Prevention and Management: An International Journal, (2008))*

Static inhibitors in industrial processes

Items such as drums and containers can have their conductivity affected by paints, coatings, or a build-up of product deposits. These static inhibitors can be thick enough to keep electrostatic charges from dissipating altogether and can impede the integrity of grounding clamp connections. The solution is to use a grounding system with clamps that can pierce paint for a good metal on metal, low resistance connection.

By providing a high intensity flashing green LED when a positive connection to earth has been made, the **Bond-Rite® range** monitors the path to earth as well as reassuring the operator throughout the duration of the operation.

Passive grounding versus active monitoring with the Bond-Rite® range

In a typical drum filling operation, the standard approach of static grounding protection will be to earth the drum with a basic clamp and cable. Electrical isolators such as those inhibitors listed above prevent the clamp teeth from making a solid reliable connection to the drum. Following repeated opening and closing cycles, clamp springs can stiffen losing their capability thereby reducing their capacity to make a reliable connection to equipment.




The Bond-Rite® CLAMP is a self-testing clamp with visual indication and monitoring

A **Bond-Rite® CLAMP** or **Bond-Rite® REMOTE** can provide workers with a visually verified earth connection to the site's grounding network. Once the operators have attached the clamp the high intensity flashing green LED confirms a low resistance connection to the drum. As long as the green LED is flashing, the operator can work safe in the knowledge the Bond-Rite® will continuously monitor the circuit ensuring static charge generated by the operation is transferred away from the potentially explosive atmosphere.

Imagine a scenario where up to 10 drums can be filled with portable pumps at a dedicated solvent filling location at any one time. Due to the pumps being held by the operators it requires them to continuously 'eyeball' the liquid level in the drum. When management risk assess and analyze between interlocking the pumps with that of a manual shutdown by the operator, they deem it sufficient for the operator to both start and stop the pump in response to visual indication of each drum's earth connection.

A solution like the Bond-Rite® REMOTE EP can be specified to combine each circuit monitoring with visual indication, providing an additional layer of protection when monitoring multiple drums off a single power supply on a 24/7 basis.

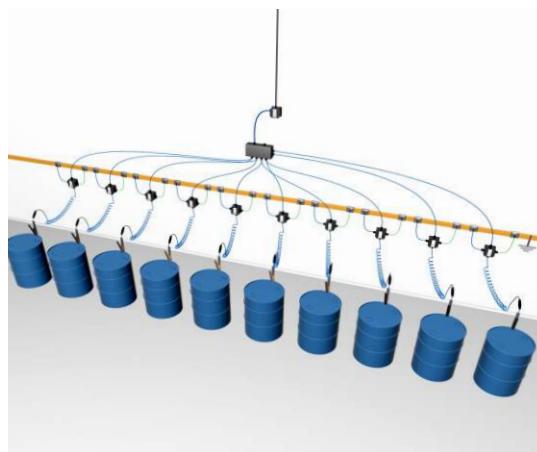

The marshalling box can be installed in Class I Division 1 and distribute power to up to 10 Bond-Rite® REMOTE units.

The benefit of this type of solution is that it closes the gap between no visual indication via “passive” grounding clamps and “off-the-shelf” grounding solutions with interlocks that require a mains line supply, or a DC supply delivered to 10 separate grounding systems operating in the hazardous area. A solution like the Bond-Rite® REMOTE EP, which only requires a single 230 v AC feed to its Class I Division 2 mounted power supply, can deliver Intrinsically Safe (IS) power to 10 ground monitoring indicators suitable for Class I Division 1 area, which can then independently monitor the grounding status of each individual drum.

If filling is carried out on a less routine basis, installation time can be reduced by specifying ground monitoring status indicators that are powered by their own internal battery.

For somebody tasked with controlling static ignition hazards, solutions tend to fall between passive clamps and cables and static grounding systems. A passive clamp and cable provide a low level of scrutiny when dissipating static, but as an introductory level of protection may be sufficient and must be considered a fundamental requirement. Static grounding systems offer the most layers of control and protection over static ignition risks, particularly as they can monitor the integrity of the connection to the process equipment, provide a visual indication to operators of a positive, low resistance, earth connection ([Bond-Rite® range](#)) and shut down the process if the grounding is compromised ([Earth-Rite® range](#) only).

The benefit for product specifiers and buyers, particularly for processes that cannot be interlocked, is that they can enhance the controls over their static ignition hazards to a much higher level than passive clamps without having to stretch their budget to the more established static grounding systems with interlocks.

Passive monitoring

- A metallic grounding clamp designed to provide a resistance of 10 ohms or less.
- If there is a ‘break’ in the connection or the resistance to earth rises above 10 ohms, there is no way of knowing during the operation.
- Unable to confirm a good earth connection before the process begins.

NFPA 77, 7.3.1.6.1 “Bonding and Grounding” states:

“Where the bonding/grounding system is all metal, resistance in continuous ground paths is measured to verify mechanical integrity. (See A.3.3.2) Such systems include those having multiple components. Greater resistance usually indicates that the metal path is not continuous, usually because of loose connections or corrosion. A permanent or fixed grounding system that is acceptable for power circuits or for lightning protection is more than adequate for a static electricity grounding system. Static grounds should be made to the building steel, if possible. Grounding to power grounds or lightning protection systems is not recommended.”

A.3.3.2 Bonding

“A resistance not exceeding 10 ohms for copper wire or 25 ohms for stainless steel or other metals is typically found in practice. Higher resistances could indicate a lack of mechanical integrity.”

IEC TS 60079-32-1, 13.3.1.4 “Movable metal items” states:

“Portable conductive items (e.g. trolleys equipped with conductive rollers, metal buckets etc.) are earthed through their contact with dissipative or conductive floors.”

However, in the presence of contaminants like dirt, or paint on the contact surface of either the floor or the object the leakage resistance to earth may increase to an unacceptable value resulting in possible hazardous electrostatic charge on the object. Where such situations are expected, the object should be earthed by an alternative means (e.g. earthing cable). A connection resistance of $10\ \Omega$ between the cable and the item to be earthed is recommended.”

Note: Always check for and read the latest version of the International Standards Guidance and/or Recommended Practices.

Active monitoring

- Provides a resistance of 10 ohms or less as indicated via a high intensity flashing green LED within the system enclosure or on the Bond-Rite® CLAMP.
- The green (GO) indication aids the SOP, e.g., do not proceed until the LED has gone green.
- Operators and plant personnel are accountable and secure about their working environment. Provides confidence that the process is reliably earthed before the operation commences.

- Performance is continuously monitored throughout the duration of the operation.

Self-testing clamps with visual indication and monitoring

The **Bond-Rite® range** from Newson Gale provides enhanced safety and security by continuously testing the connection of the clamp to the drum or other metallic items of plant equipment in a complete loop made via the designated grounding point.

Designed for process areas where interlocking (automatic shutdown) is not possible/or required, operation is manual and monitored by an operator's presence or where the process times are not permanent. These systems are designed around processing hazards where the responsibility is placed on the operator to provide the grounding process. Such restrictions do not mean that specifiers must take a downward leap to passive grounding clamps (non-monitored).

An intermediate layer of static grounding control is possible by installing **Bond-Rite®** solutions that can continuously monitor and verify that the resistance between the equipment to be grounded and a true earth ground source is 10 ohms or less.



Summary

To mitigate electrostatic discharges igniting combustible and flammable atmospheres, companies should risk assess their processes and equipment to ensure any potential sources of ignition are identified and managed correctly. Incendive electrostatic sparks usually result from the lack of a thorough and detailed risk assessment, unintended changes to equipment during routine maintenance and unsafe operator working practices. All potential sources of internal and external static discharges from process equipment situated in zoned and classified areas must be accounted for and managed in the appropriate way.

The primary mindset should be to source a grounding solution that provides the best level of protection and is capable of being incorporated alongside current operations. The more layers of control deployed to protect against an ignition source, the more likely static will be controlled in a safe, repeatable and reliable way, day in and day out. Naturally, the most desirable method of control is the prevention of charge accumulation, this however, is rarely attainable without additional

consideration. The solution lies in preventing charge from accumulating to unsafe levels where a discharge is likely to occur.

The object of static control measures is to provide a means by which charge can safely dissipate to ground. The most secure means of preventing charge accumulation is to provide a reliable path to a verified ground point via grounding and bonding methods. It is fundamentally critical to take necessary precautions to prevent discharges that are powerful enough to cause ignition in a flammable or combustible atmosphere.

To help control these risks, Newson Gale offers a wide range of static grounding and bonding equipment which is made to provide optimum safety in explosive atmospheres for a variety of process applications. The Newson Gale range mitigates static charge accumulation by using practical and innovative design and ensures effective static control on three levels – grounding and bonding clamps, visual verification systems and interlockable control systems.

Copyright Notice

The document and its content is copyright of Newson Gale Ltd © 2024. All rights reserved.

Any redistribution or reproduction of part or all of the contents in any form is prohibited other than the following:

- You may print or download to a local hard disk extracts for your personal and non-commercial use only
- You may copy the content to individual third parties for their personal use, but only if you acknowledge the website as the source of the material

You may not, except with our express written permission, distribute or commercially exploit the content. Nor may you transmit it or store it in any website or other form of electronic retrieval system.

Right to change

This document provides general information only and may be subject to change at any time without notice. All information, representations, links or other messages may be changed by Newson Gale at any time without prior notice or explanation.

Newson Gale is not obliged to remove any outdated information from its content or to expressly mark it as being outdated. Please seek the advice of professionals as necessary regarding the evaluation of any content.

Disclaimer of liability

The information provided in this document is provided by Newson Gale without any representations or warranties, expressed or implied, as to its accuracy or completeness. The liability of Newson Gale for any expenses, losses or actions incurred whatsoever by the recipient as a result of the use of this document shall be excluded.

United Kingdom

Newson Gale Ltd
Omega House, Private Road 8
Colwick, Nottingham
NG4 2JX, UK
+44 (0)115 940 7500
groundit@newson-gale.co.uk

United States

IEP Technologies LLC
417-1 South Street
Marlborough, MA 01752
USA
+1 732 961 7610
groundit@newson-gale.com

Germany

IEP Technologies GmbH
Kaiserswerther Str. 85C
40878 Ratingen
Germany
+49 (0)2102 5889 0
erdung@newson-gale.de