

## WHY ONLY MEASURE TO AN UPPER RESISTANCE THRESHOLD IN FIBC ELECTROSTATIC GROUNDING?

Reliable electrostatic grounding is key to safe hazardous location operations using Type C FIBCs. The reliability of this connection to ground includes an upper resistance limit in order to allow the safe dissipation of charge, as reflected in the relevant national and international safety standards. However, while these standards provide guidance on an upper resistance limit, it may appear to be even safer to include a lower resistance limit as well, so that the correct object can be identified and to prevent attempts to bypass or manipulate the system.

This article examines the recommended practice to establish an electrostatic grounding connection for Type C FIBCs to an upper resistance threshold for confirmation of the connection to a verified grounding point on site, and why the addition of a lower resistance threshold may not be quite as beneficial as it appears.

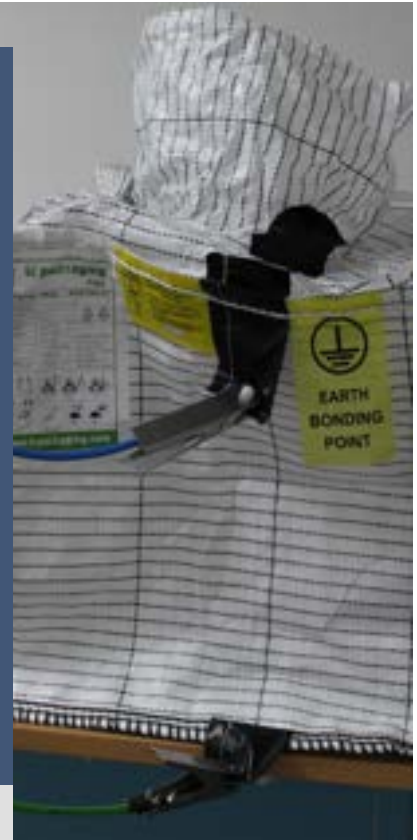


Figure 1 - An example of a safe connection to an grounding point.

### Standards compliance

The answer to the first part lies in the standards and industry best practice for hazardous location FIBC operations. Firstly, particularly for operators in Europe, the ATEX workplace safety directive sets out a requirement to prevent the ignition of an explosive atmosphere, including preventing ignition sources such as electrostatic sparks.<sup>1</sup>

A more specific requirement for FIBC grounding is set out in the International Electrotechnical Commission's guidance with IEC TS 60079-32-1, which states that "Type C FIBC are designed to be connected to ground during filling and emptying operations."<sup>2</sup>

As to the nature of this electrostatic grounding connection, the National Fire Protection Association's recommended practice NFPA 77<sup>3</sup> and international standard IEC 61340-4-4 agree that a Type C FIBC used for transfer operations in flammable or explosive atmospheres "shall have a resistance to groundable point of less than  $1,0 \times 10^8 \Omega$ ".<sup>4</sup> The international standard has then in turn been adopted in a number of national standards, including the British BS EN IEC 61340-4-4<sup>5</sup> and German DIN EN IEC 61340-4-4<sup>6</sup>.

Annex F of the IEC 61340-4-4 provides further detail on the reasoning behind this upper limit,<sup>7</sup> which is based on research undertaken by Yamaguma *et al*, and reaches the conclusion

that "a heavy-duty Type C FIBC of slightly less than  $1 \times 10^8 \Omega$  is quite unlikely" to become an ignition source even when exposed to an "unrealistically large static current of  $30 \mu\text{A}$ ,"<sup>8</sup> as long as it is suitably grounded.

In short, even when subjecting the bag to a higher electrostatic streaming current that could realistically be expected during normal transfer operations, the tested Type C FIBCs stubbornly refused to act as an ignition source when provided with a connection to ground of slightly less than  $1.0 \times 10^8 \Omega$ .

There are numerous advantages to working with this upper resistance threshold as the foundation of an active electrostatic grounding solution. In addition to significantly reducing the risk of fire or dust explosion during operation, using an active electrostatic grounding solution allows operators to monitor the safe connection to the site's verified grounding point with visual indication of a good connection, provide indication if this connection is interrupted, and allow for interlocks with process equipment to automatically shut off if the connection is disrupted.

It is important to note at this point that while the standards and the research on which they are based are clear on this upper resistance threshold, there is no mention of a lower resistance threshold at the other end of the scale.

## Why no lower limit?

As far as the standards are concerned, the resistance of a Type C FIBC to ground can be  $1.0 \times 10^9 \Omega$ ,  $100 \Omega$ , or  $1 \Omega$ , and the way the grounding connection works would remain unchanged. The addition of a lower resistance threshold *ipso facto* adds additional complexity to the monitoring circuit, which provides additional possible points of failure or inconsistency in operation.


In exchange for this added complexity, where lower resistance limits are put forward, the proposed benefit can be less in terms of conforming to the standards and best practice, and more as a form of object recognition, attempting to make the system foolproof, or allowing the system to be used in place of trained or competent operators. Each of these possible benefits can be examined in turn.

## Object recognition

For object recognition, the proposition is that an operator may – by mistake or intentionally trying to bypass the system – connect a grounding clamp to an object other than a Type C FIBC. If that object is not conductive, such as a block of wood or article of clothing, its resistance will be higher than the monitored upper limit and the system will not go permissive. If the object is conductive, such as a metal tool or guardrail, the resistance will be lower than the monitored lower limit and the system will not go permissive. Therefore, the proposition goes, only a correct connection to a Type C FIBC will allow the system to go permissive.

This distinction makes intuitive sense but overlooks a crucial detail that other objects are able to fit within a window of permissible resistance of, for example,  $100 \Omega - 1 \times 10^8 \Omega$ , but are in fact not Type C FIBCs.

This not only brings the role of object recognition into question when used with a known Type C FIBC but also raises the possibility of a false positive if the system can be made to give a permissive signal when connecting to an object other than the intended bag.

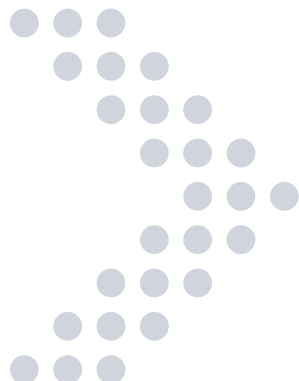

## Foolproof?

This plays into the second assumption, that object recognition provided by a lower resistance limit can make a system foolproof or impossible to manipulate. To quote Douglas Adams, a common mistake that people make when trying to design something completely foolproof is to underestimate the ingenuity of complete fools.<sup>9</sup> As the list of items which fall within the resistance window includes the human body, a sufficiently determined operator has at their disposal the means to quite literally manipulate<sup>10</sup> such a system by deciding to remove a glove.



Figure 2 - Human hand, showing resistance of  $1.3 \times 10^7 \Omega$ , within Type C FIBC object recognition window.

## Replacing training and competence

This then leads us to the third assumption, that a system with automatic object recognition by means of an upper and lower resistance threshold can be used as a substitute for operator training or competence.

As with the previous issues, if a system can be fooled by a sufficiently determined person deliberately acting in bad faith or accidentally through lack of understanding, a solution which simply raises higher barriers without addressing underlying safe operating procedures may encourage bad actors to regroup and try again or operators without the necessary training or competence to roll the dice again for another unintended outcome.

Instead, the purpose of an grounding solution which monitors to the recommended upper resistance level only is to support trained and competent operators in carrying out their work safely.

This can include acting as an automatic check that the standard operating procedure is in alignment with the relevant standards, a prompt to help ensure that safe standard operating procedure is followed by having the system's "go" signal as part of an operational checklist, and providing an automatic notification or shutoff response in the event that the connection is accidentally disrupted during operation.




Figure 3 - Potato, showing resistance of  $3.5 \times 10^4 \Omega$ , within Type C FIBC object recognition window.

## Conclusion

What conclusions may be drawn from this?

On the one hand, it has been demonstrated that the use of an upper resistance threshold for Type C FIBC grounding connections carries a number of key benefits, including the safe dissipation of electrostatic charge mitigating the risk of the formation of an incendive spark in hazardous location operations, conformance to the relevant standards and industry best practice, and supporting safe working procedures to be carried out by trained and competent operators.

On the other hand, the use of a lower resistance threshold comes with significant drawbacks. In addition to the increased complexity of the monitoring circuit forming an open invitation to Murphy's law, the use of this permissive window to act as object recognition has some important limits to what can be recognized as a permissible object. The attempt to make a system foolproof and impossible to manipulate can still leave it open to being fooled and manipulated, and false positives can add another location of uncertainty. Finally, an automated system alone is no replacement for operators' training and competence or safe standard operating procedure.

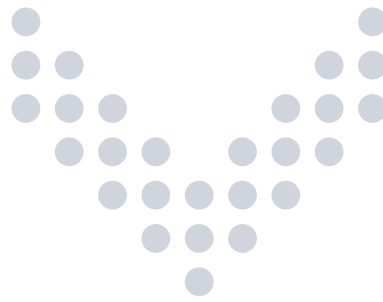

## FAQ

**What is a Type C FIBC?** Flexible Intermediate Bulk Containers (FIBCs) are divided into different types for different applications. Type C FIBCs incorporate a network of conductive threads or carbon-loaded fabrics in order to allow them to safely dissipate electrostatic charge when connected to an grounding point.

**Why do Type C FIBCs need to be grounded?** Electrostatic charge can accumulate on FIBCs during filling and emptying operations if no grounding connection is in place, which can cause a spark capable of igniting a flammable or explosive atmosphere. An electrostatic grounding solution allows this risk to be controlled, helping to improve safety for processes, sites, and operators.

**How can a Type C FIBC be safely grounded?** Clamp and cable connections between the Type C FIBC and a verified grounding point on site can allow for the safe dissipation of electrostatic charge. The use of two clamp connections with a monitoring system can allow this connection to be continuously monitored, providing visual indication of a good connection and interlocks with process equipment to initiate automatic shutoff if the connection is disrupted.

**What do the standards and guidance documents say?** IEC TS 60079-32-1 requires an electrostatic grounding connection for Type C FIBCs in hazardous location operations. NFPA 77 and EC 61340-4-4 require that the resistance between the FIBC and the local grounding point to be lower than a maximum resistance threshold.

**What is the maximum resistance threshold for Type C FIBC grounding?**  $1 \times 10^8 \Omega$  (100 M $\Omega$ ).

## Next steps

[Click here](#) to access Newson Gale's knowledge hub for further information

[Click here](#) to access Newson Gale's grounding and bonding handbook

[Click here](#) to contact Newson Gale's sales team for further discussion of specific applications and grounding solutions

- <sup>1</sup> Directive 1999/92/EC of the European Parliament and of the Council of 16 December 1999 on minimum requirements for improving the safety and health protection of workers potentially at risk from explosive atmospheres, Article 3.
- <sup>2</sup> IEC Technical Specification 60079-32-1 Explosive atmospheres - Part 32-1: Electrostatic hazards, guidance § 9.6.1
- <sup>3</sup> NFPA 77 (2024) Recommended Practice on Static Electricity
- <sup>4</sup> IEC 61340-4-4:2018 Electrostatics - Part 4-4: Standard test methods for specific applications - Electrostatic classification of flexible intermediate bulk containers (FIBC) § 7.3.1
- <sup>5</sup> BS EN IEC 61340-4-4:2018 *Electrostatics - Standard test methods for specific applications. Electrostatic classification of flexible intermediate bulk containers (FIBC)*
- <sup>6</sup> DIN EN IEC 61340-4-4:2019-01, VDE 0300-4-4:2019-01, *Elektrostatik - Teil 4-4: Standard-Prüfverfahren für spezielle Anwendungen - Einordnung flexibler Schüttgutbehälter (FIBC) in elektrostatischer Hinsicht (IEC 61340-4-4:2018)*; Deutsche Fassung EN IEC 61340-4-4:2018
- <sup>7</sup> IEC 61340-4-4, op. cit., Annex F
- <sup>8</sup> Yamaguma, M., Goto, K., Kokubun, A., A study on resistance of anti-electrostatic flexible intermediate bulk containers, J. Chem. Eng. Jap. Vol. 8 No. 8 (708-714), 2015
- <sup>9</sup> Adams, Douglas (1992). Mostly Harmless. Pan in association with Heinemann.
- <sup>10</sup> From the Latin manus, "hand"



**United Kingdom**  
Newson Gale Ltd  
newson-gale.co.uk

Omega House  
Private Road 8  
Colwick, Nottingham  
NG4 2JX, UK  
+44 (0)115 940 7500  
groundit@newson-gale.co.uk

**United States**  
IEP Technologies, LLC  
newson-gale.com

417-1 South Street  
Marlborough  
MA 01752  
USA  
+1 732 961 7610  
groundit@newson-gale.com

**Deutschland**  
IEP Technologies GmbH  
newson-gale.de

Kaiserswerther Str. 85C  
40878 Ratingen  
Germany  
+49 (0)2102 5889 0  
erdung@newson-gale.de

Copyright Notice

The document and its content is copyright of Newson Gale Ltd © 2026. All rights reserved.

Any redistribution or reproduction of part or all of the contents in any form is prohibited other than the following:

- You may print or download to a local hard disk extracts for your personal and non-commercial use only.
- You may copy the content to individual third parties for their personal use, but only if you acknowledge the website as the source of the material.
- You may not, except with our express written permission, distribute or commercially exploit the content. Nor may you transmit it or store it in any other website or other form of electronic retrieval system.

Right to change

This document provides general information only and may be subject to change at any time without notice. All information, representations, links or other messages may be changed by Newson Gale at any time without prior notice or explanation.

Newson Gale is not obliged to remove any outdated information from its content or to expressly mark it as being outdated. Please seek the advice of professionals as necessary regarding the evaluation of any content.

Disclaimer of liability

The information provided in this document is provided by Newson Gale without any representations or warranties, expressed or implied, as to its accuracy or completeness. The liability of Newson Gale for any expenses, losses or actions incurred whatsoever by the recipient as a result of the use of this document shall be excluded.